


FIGURE 7
Service Mast

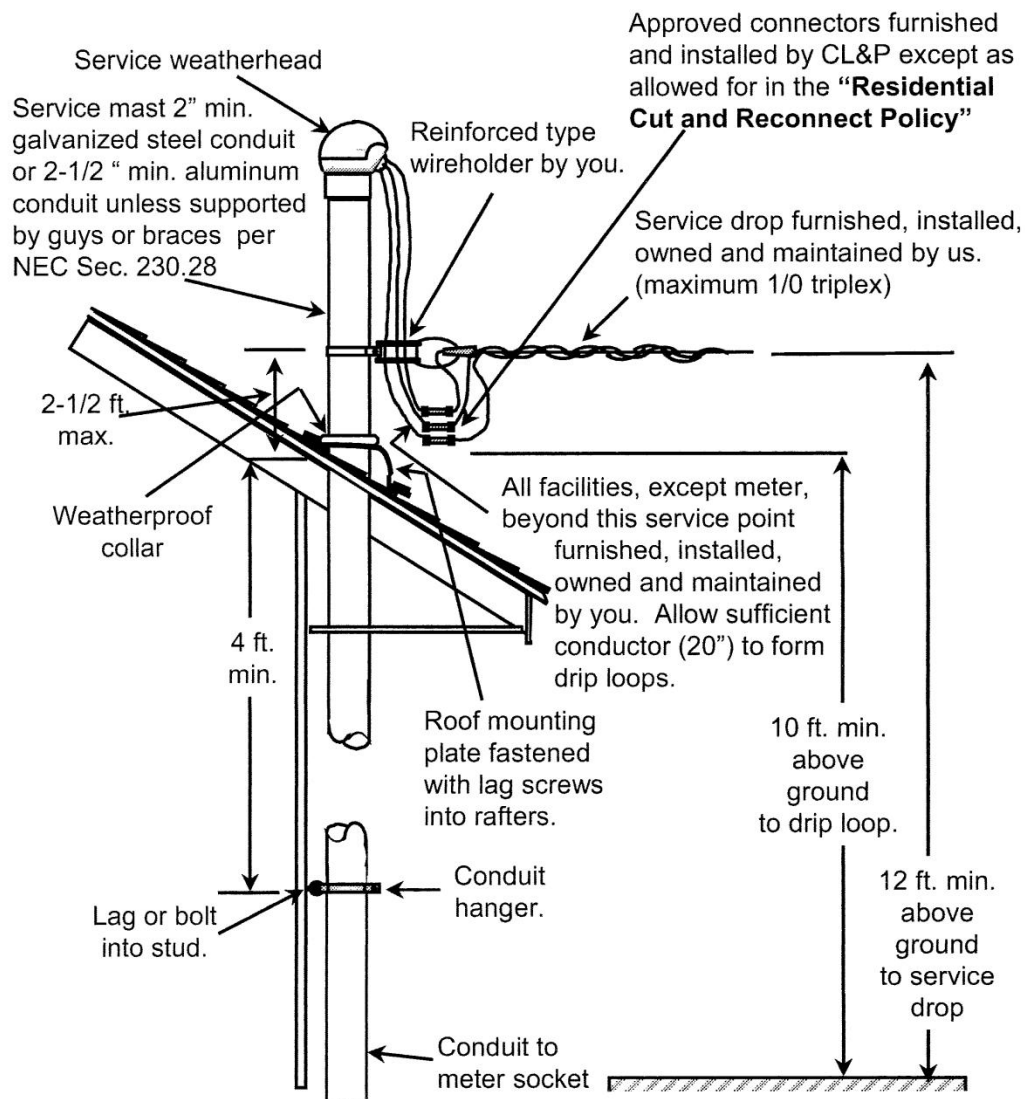

Note:

Only power service drop conductors shall be permitted to be attached to a service mast (per NEC Section 230.28).