



FIGURE 3
Conduit Service: Supply End

A. Supply From Our Conduit System

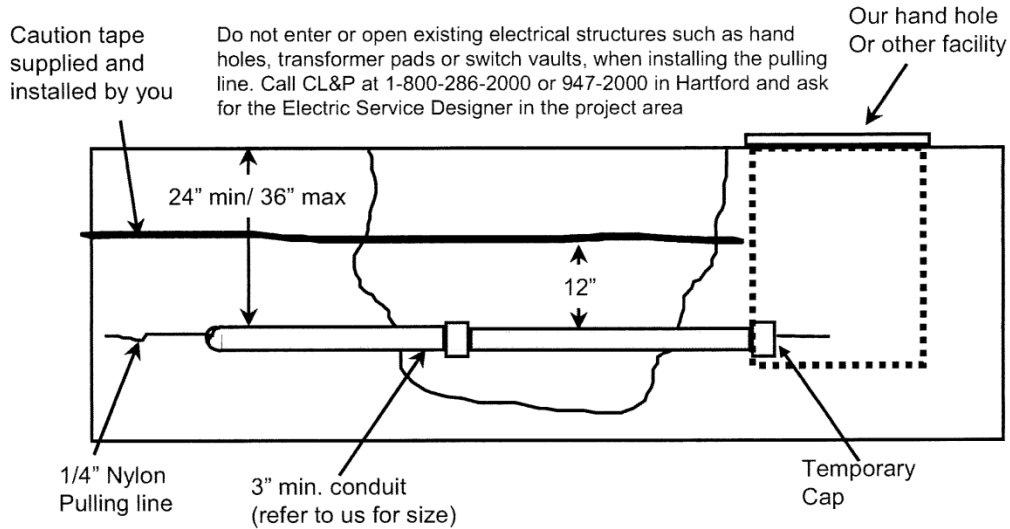

B. Supply From Our Overhead System

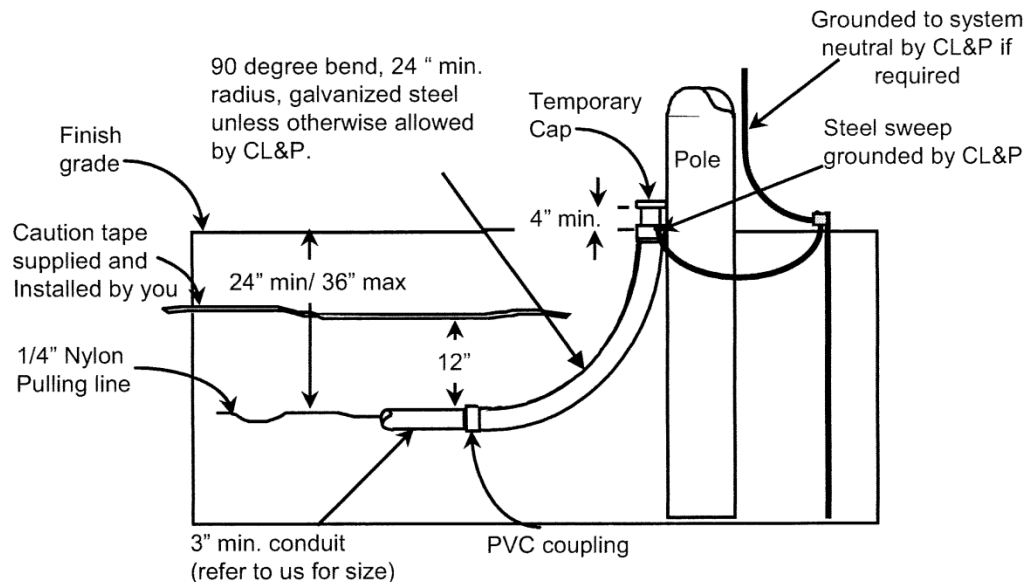

Note:

1. Provide suitable backfill (no rocks)
2. All conduit shall be inspected by the local municipal authority prior to backfilling.
3. Electric service sweeps shall be located on the pole side away from oncoming traffic.